

FIG.1

00001" 0505/200

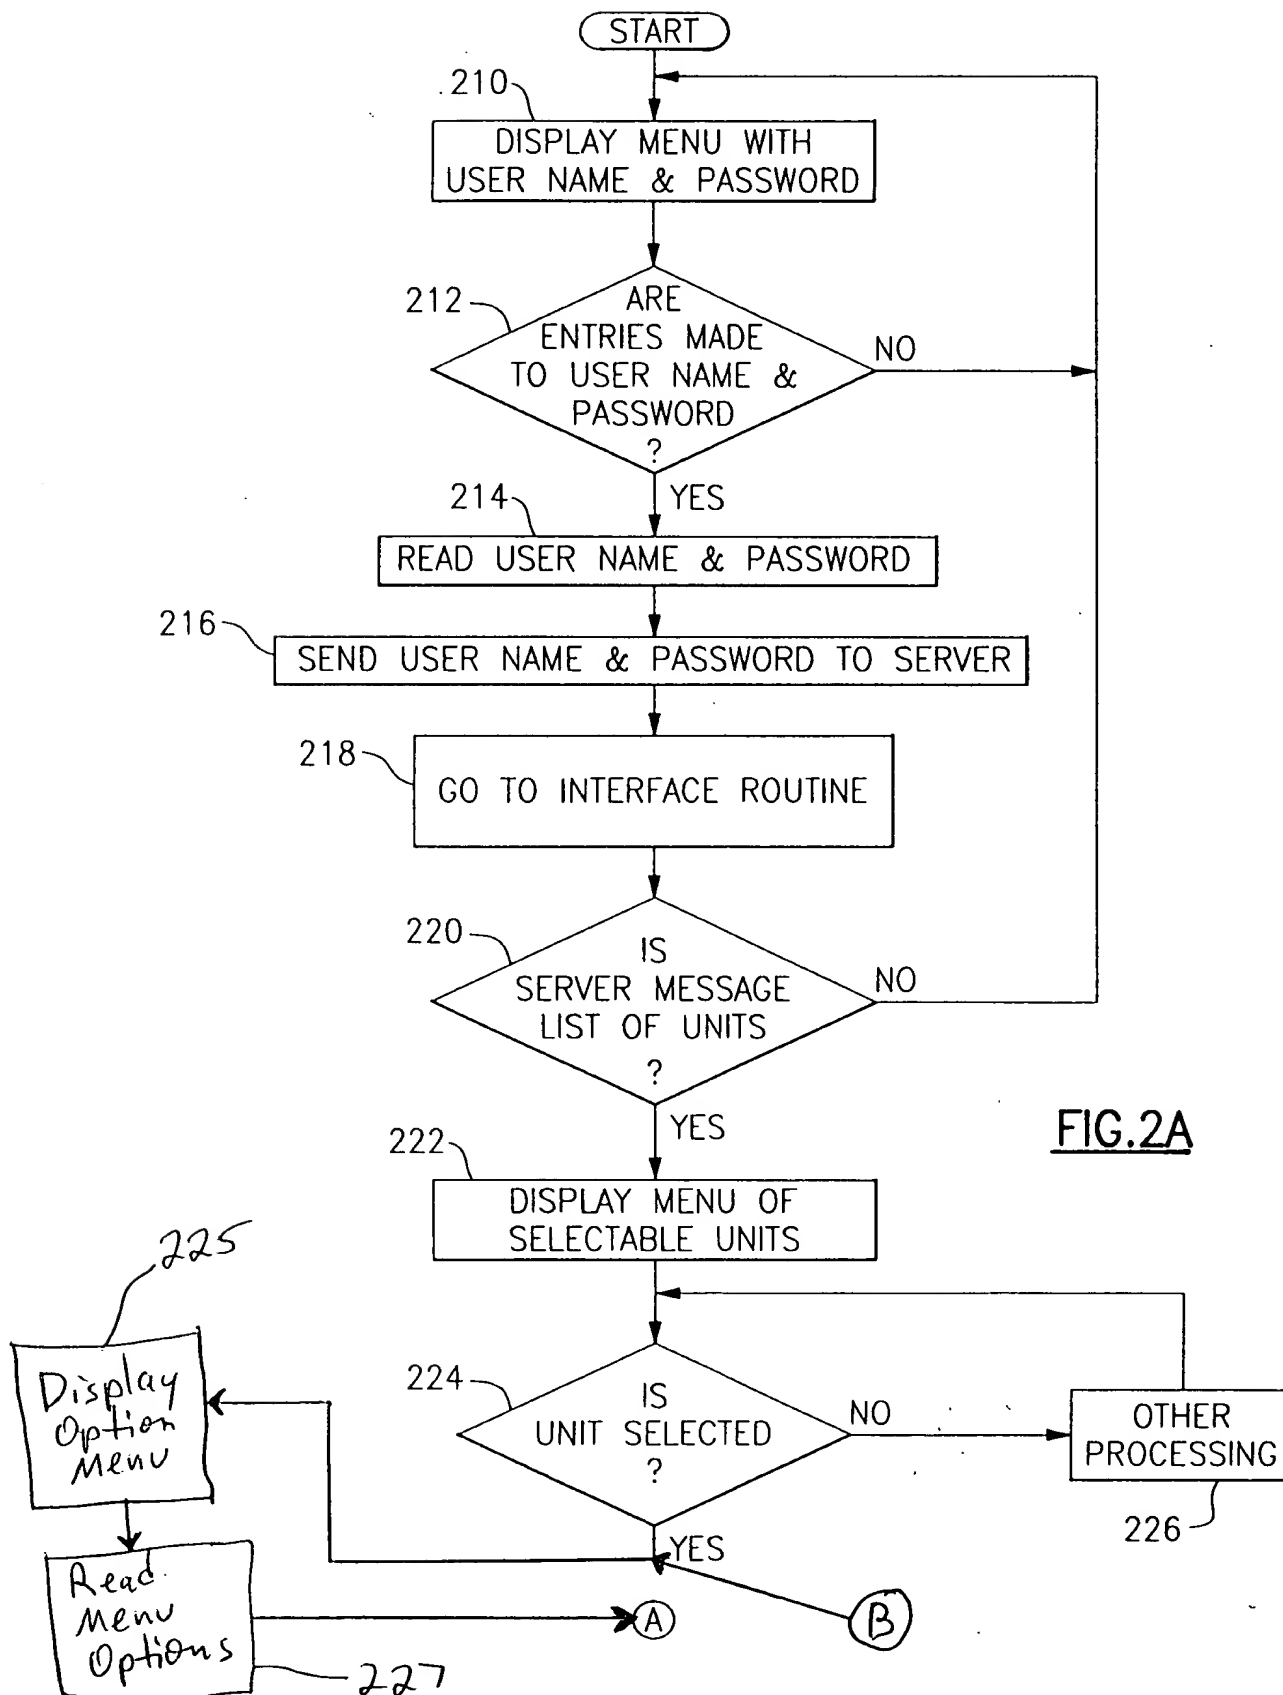


FIG.2A

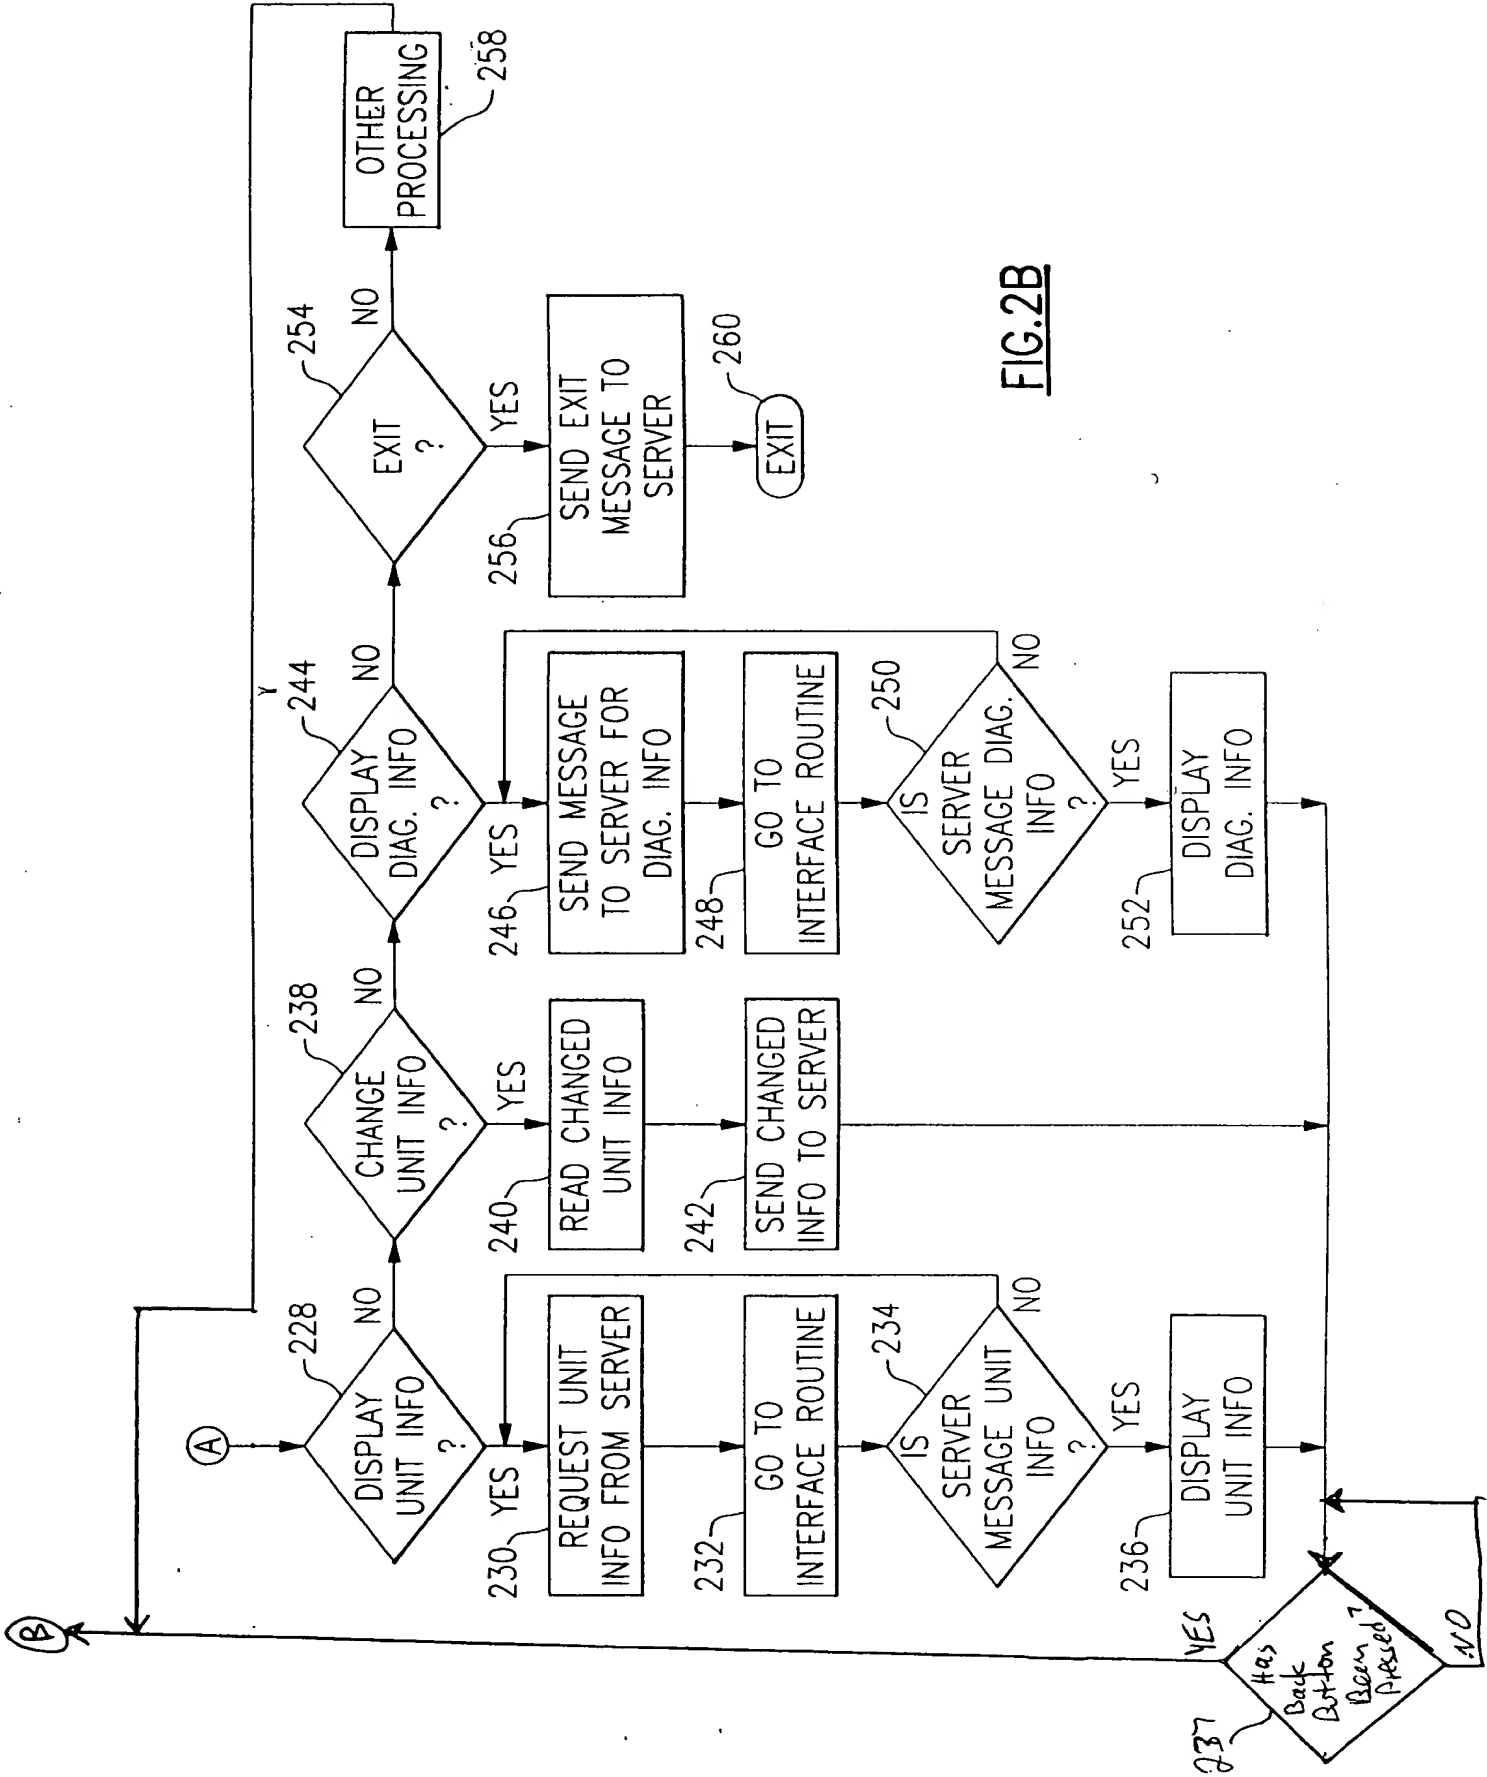
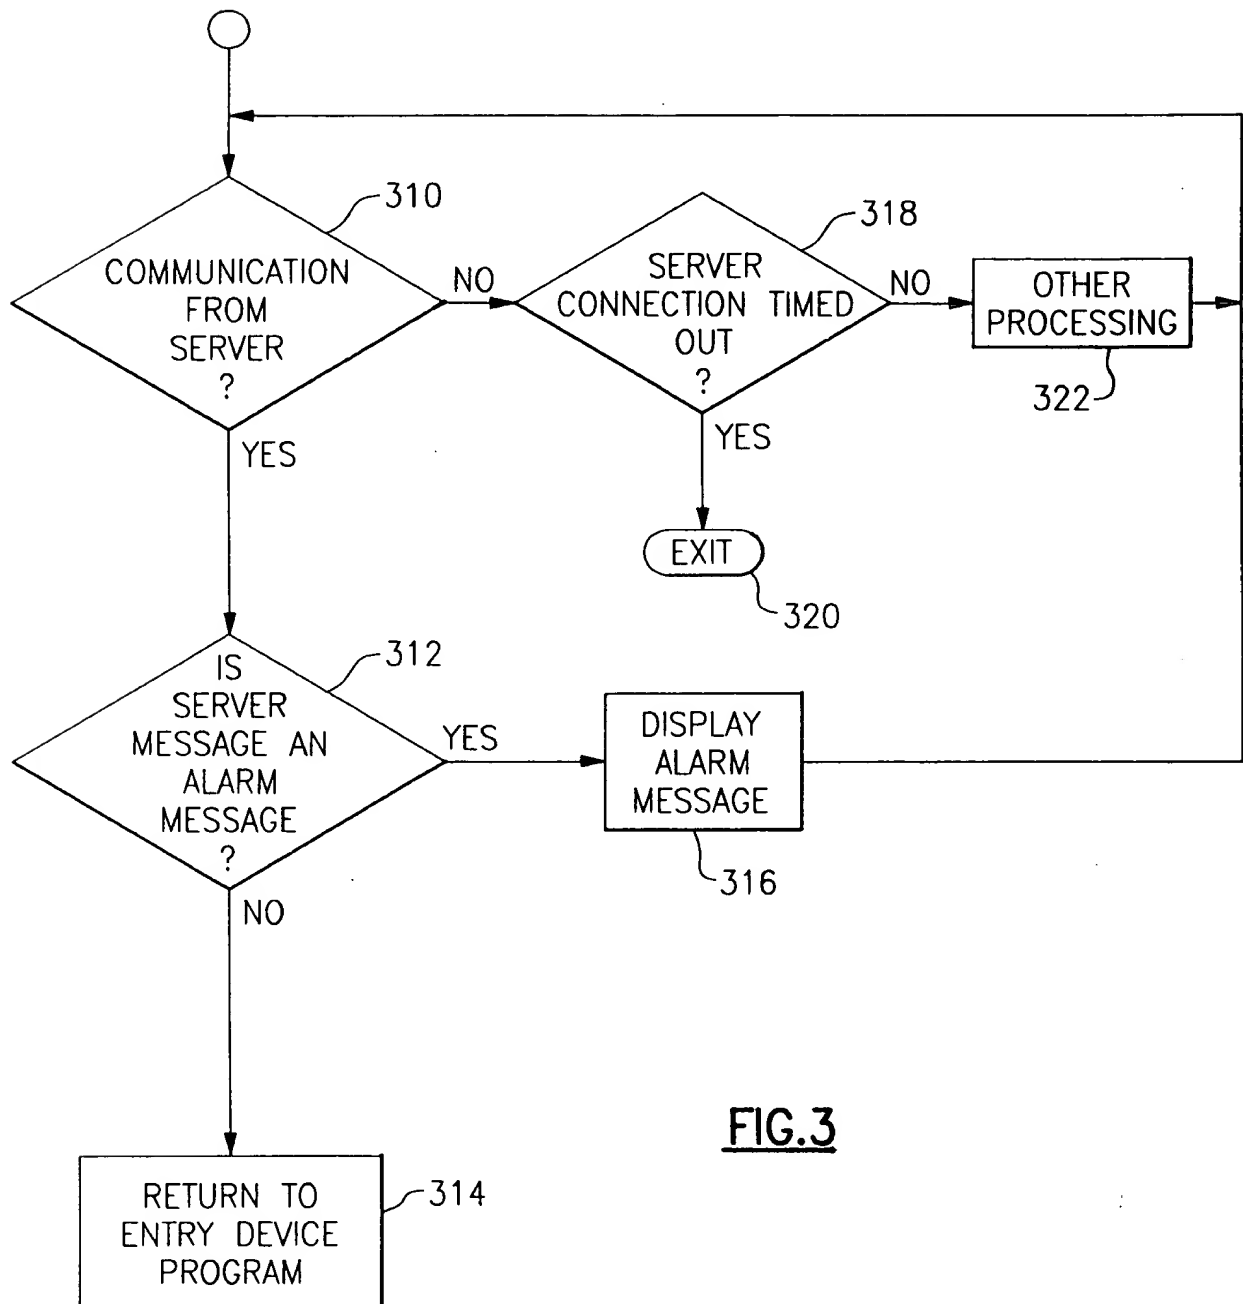


FIG. 2B




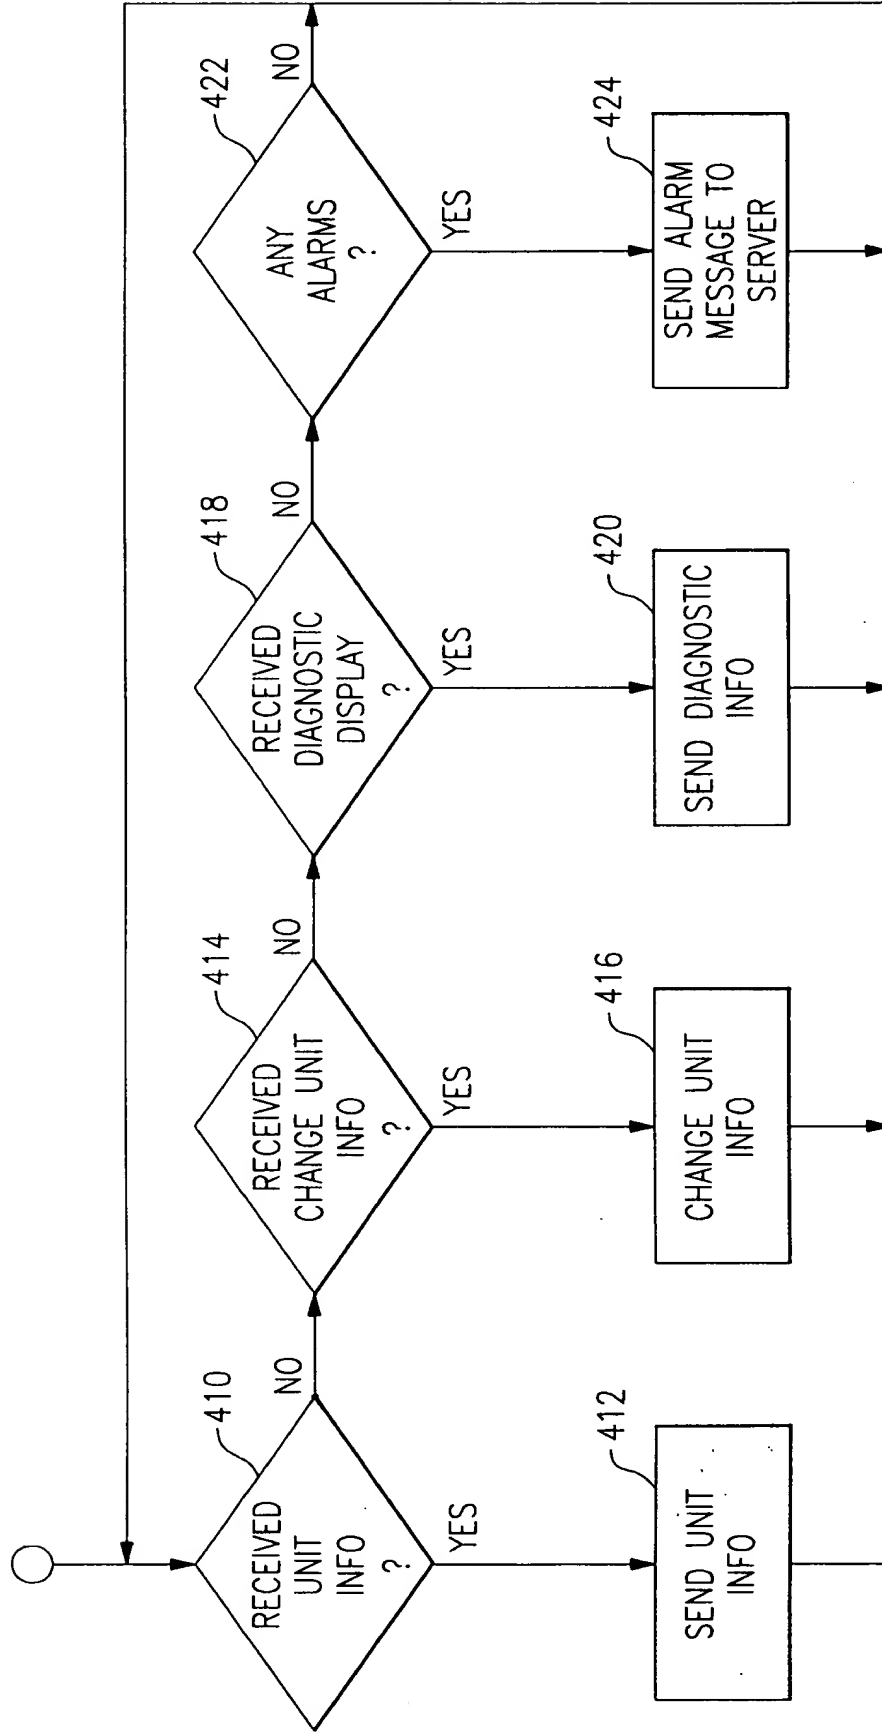


FIG. 4

Fig. 5

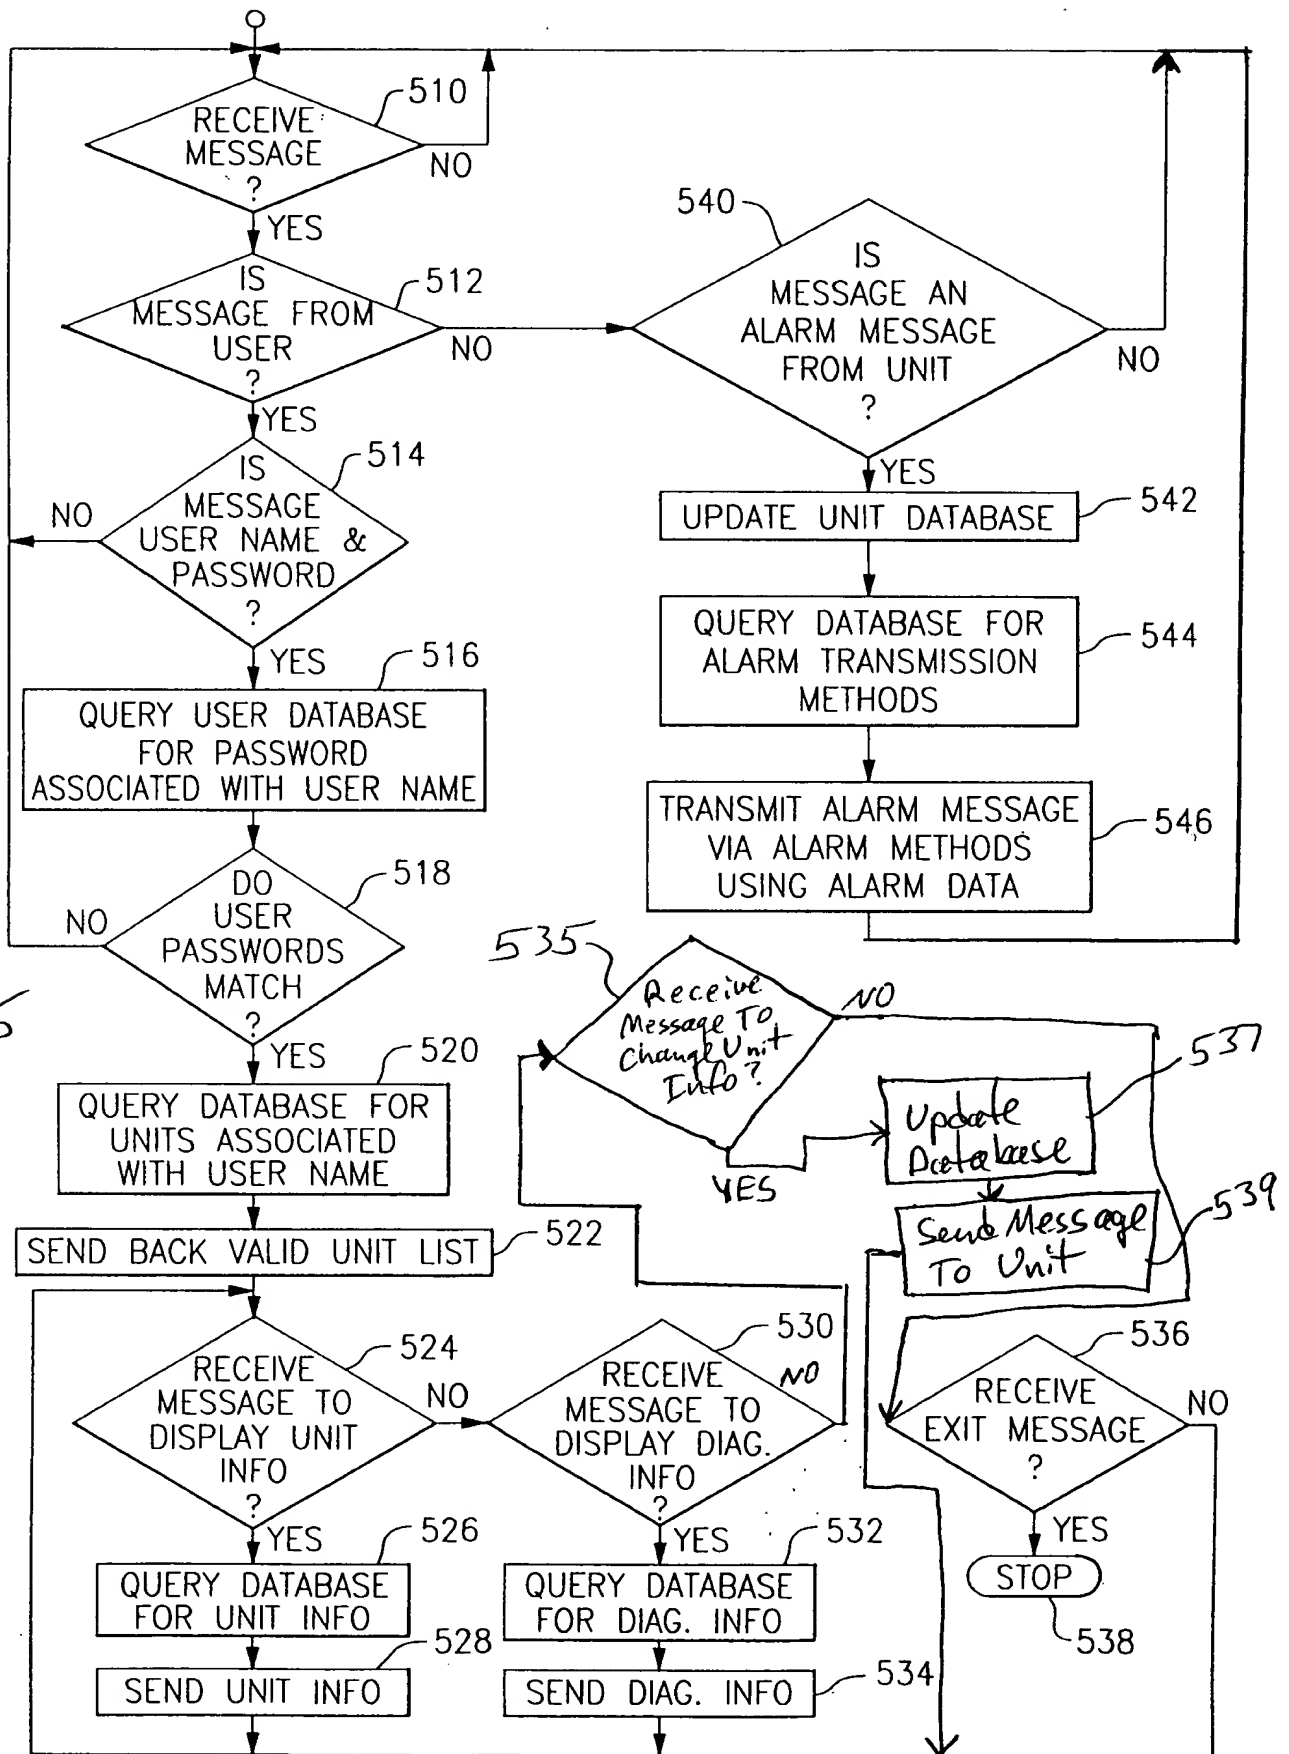

005001" E5862960

USER DATABASE

USER NAME	PASSWORD	UNIT 1	UNIT 2	...	UNIT N
CARRIER 1	123456	OFFICE	MILAN	...	FRANCE
CARRIER 2	654321	LOBBY	MILAN	...	

Fig. 6

UNIT DATABASE

UNIT NAME	UNIT PHONE #	POWER	MODE	ROOM TEMP	SETPOINT	FAN SPEED	LOWER	TIMER	DIAGNOSTIC	ALARM METHOD 1	ALARM DATA 1
OFFICE	(123)456-7890	ON	HEAT	22	22	LOW	1	OFF	NONE	E-MAIL	XYZ@CARRIER.UTC.COM
MILAN	(234)567-8901	OFF	OFF	23	22	OFF	HOME	OFF	NONE	PHONE	(555)123-4567
FRANCE	(345)678-9012	ON	COOL	24	22	MEDIUM	6	OFF	NONE	E-MAIL	XYZ@CARRIER.UTC.COM
LOBBY	(456)789-0123	ON	FAIL	25	22	OFF	HOME	OFF	ROOM AIR	SMS	(555)234-5678

Fig. 7